


Archives and Microfilm Dept 3022 West Wilden Avenue Goshen, Indiana 46528

| Location | | Structural Inconsistencies | | Recommended Corrections/Modifications Technica to Provide Access | | I Information | | Finalized Actions | | | |
|----------------------------|-------|---|------------------------|---|---|---------------------|--------------------------------------|---|------------------------|-----------------------|--|
| Location | Photo | Identified Issue | ADAAG Specification | | Priority Ranking and Justification | Improvement Cost | Funding Source | Finalized Correction | Anticipated Date of | Date of Completion | |
| 1. Parking | | No accessible parking spaces provided. There are 10 spots in the lot, so 1 accessible spot is required. | 4.1.2 4.6.4 | ADAAG requires one accessible spot for every 25 spots available. This spot should be located closest to the entrance to the building. Restripe the parking lot to include one accessible spot. The spot should be van accessible and include loading area. | H: An accessible spot is a neccessity at every building. | \$250 | Elkhart County General Fund | Restriped lot | | Jul-14 | |
| 2. Parking | | No "Van Accessible" sign at van accessible parking space. No enforcement procedure for accessible parking | 4.6.4 | ADAAG requires accessible parking spaces to be located in each parking lot. Accessible parking spaces are required to have upright signage that incluces the symbol of a accessibility and van accessible signage where required. Add one "Van Accessible" sign. Enforce parking regulations. | H: This will be completed when the spot is added. | \$125 | Elkhart County General Fund | Added Van Accessible sign. | | Aug-14 | |
| 3. Registration Counter | | Registration counter exceeds the maximum height. The counter is 42" high. | 7.2 | ADAAG requires sale and service counters to have a maximum height of 36" above the finished floor. Lower portion of counter or provide auxillary counter at 36" height. | M: Everyone entering facility will use this counter. Employee can walk around counter to communicate. | \$1,500 | Elkhart County General Fund | Relocation of offices in the future plans | | | |
| 4. Restroom | | No signage for rest room. (not technically a public rest room) | 4.30 | ADAAG requires signage to be mounted 60" from the floor, on the wall adjacent to latch side of door, to have raised characters and Braille text. Add signage to the rest room facilites. | L: This is not a public rest room. | \$100 | Elkhart County General Fund | Sign Installed | | Jul-15 | |


| Location | | Structural Inconsistencies | | Recommended Corrections/Modifications to Provide Access | Technical Information | | Finalized Actions | | | |
|--------------------------|--|--|--------|--|---|---------------------|--------------------------------------|---|------------------------|--------------------|
| Location 5. Rest room | | • | | ADAAG requires controls and operating mechanisms to be operable with one hand and shall not require tight grasping, pinching, or twisting of the wrist. Replace existing faucet | M: This is an inexpensive easy fix that will | Improvement Cost | Elkhart County General Fund | Finalized Correction Replaced faucet controls | Anticipated Date of | Bate of Completion |
| 6. Rest room | | Lavatory apron exceeds the minimum height. Unit is 28" from floor. | 4.19.2 | ADAAG requires lavatories to be mounted with the rim or counter surface no higher than 34in above thenished floor and to provide a clearance of at least 29: above teh finish floor to the bottom of the apron. Raise the lavatory to provide 29" to finish floor. | provide considerable help. L: Pipes and plumbing may need adjusted for 1". | \$250 | Elkhart County General Fund | Raised lavatory | | Aug-14 |
| 7. Rest Rooms | | Mirror is mount height exceeds the maximum requirement. The mirror is mounted at 53" from finished floor. | 4.19.6 | ADAAG requires mirrors to be mounted with the bottom edge of the reflecting surface no higher than 40" above finished floor. Lower the mirrors. | M: This could be easily adjusted. | \$50 | Elkhart County General Fund | Lowered mirrors | | Aug-14 |
| 8. Rest Rooms | | Toilet seat exceeds the height range. Unit is 16" high. | 4.16.3 | ADAAG requires the height of water closets to be 17" to 19", measured to the top of the toilet seat. Raise the toilet. | L. IIIIS IIIay | \$100 | Elkhart County General Fund | Relocation of offices in the future plans | | |



01. Archives Parking

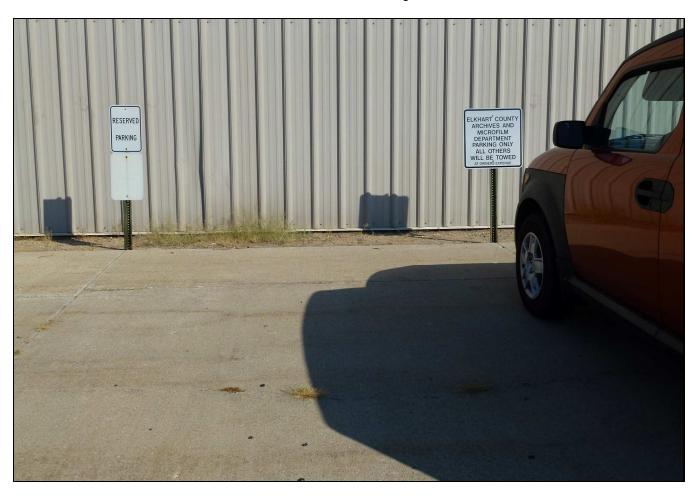

02. Archives Parking lot

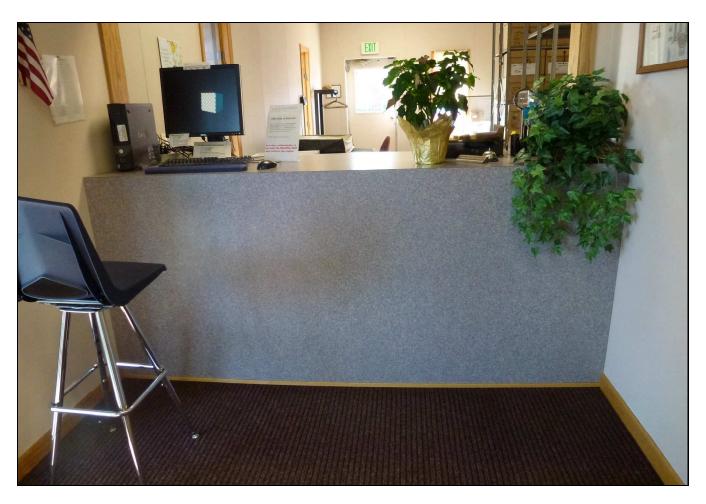

03. Archives Front Counter